

APOLLO™ Blue PVC-O Pressure Pipe Series 2 (Blue)

Compliance: Manufactured in accordance with AS/NZ 4441 Orientated PVC (PVC-O) Pipes for pressure applications for Series 2 pipe.


(Standards Mark Licence number SMKP20682.)

Product Code: 1880 Series

Applications:

- Major potable water supply trunk and reticulation mains
- Principal water mains
- Principal pressure sewer mains
- Industrial process lines
- Effluent pipelines for industrial and rural waste
- Irrigation and turf water systems

Joining: Pipe is supplied with a rubber ring joint utilizing the BlueSeal joint system where the seal ring is factory fitted and locked in place inside the pipe socket.

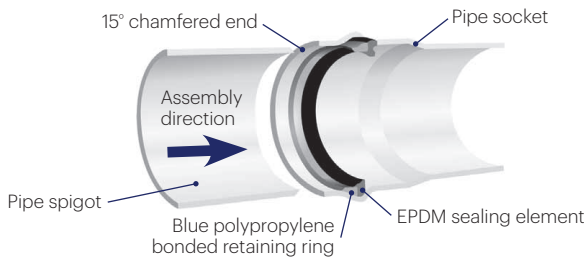

Solvent cement joints are not used with any Series 2 PVC Pipe including Apollo Blue.

Fittings: Deep socket standard ductile iron fittings complying with AS/NZS 2280 "Ductile iron pipes and fittings".

Service & Connections: Iplex recommends the use of PVC compatible, full circle supported tapping bands with APOLLO™ BLUE pipe. These include Milnes Gunmetal, Crevet Taprite or other tapping bands manufactured to AS/NZS4793 "Mechanical Tapping Bands for Water Works Purposes". Either O or V type tapping band seals are suitable for use with APOLLO™ BLUE.

"Universal" tapping bands that use U-bolt support straps are prohibited.

Tapping bands must be installed centrally positioned over the drilled service hole. This hole should be drilled using a fine-tooth hole saw. Twist Drills or flat bits MUST NOT BE USED on any PVC pipe.

Mechanical Couplings: Iplex recommends the use of unrestrained mechanical couplings manufactured to AS/NZS 4998 – Bolted Unrestrained Mechanical Couplings for Water Works Purposes.

Design & Installation: Installation methods for APOLLO™ BLUE pipes are generally the same as those used for Iplex PVC-U and PVC-M pipes. Buried pipe installation should generally be in accordance with the following standards:

- **General Installation:**
AS/NZS 2032, "Installation of PVC pipe systems".
- **Buried Structural Design:**
AS/NZS 2566 Part 1 and Supplement Structural Design.
- **Detailed Installation and Site Pressure Testing:**
AS/NZS 2566 Part 2 "Installation" On site test pressure should not exceed 1.25 x the pipe PN pressure class.

Length: 6 metre effective length. Length of the witness mark is added to give the overall length.

APOLLO™ Blue PVC-O Series 2 Pressure Pipe Dimensions					
Class	PN12.5		PN16		
Pressure rating (MPa)	1.25 MPa		1.6 MPa		
Approx rating (m head)	125m head		160m head		
Design MRS MPa	35.5 MPa		45.0 MPa		
Nom. Dia (mm)	Mean O.D. (mm)	Mean I.D. (mm)	Mean W.T. (mm)	Mean I.D. (mm)	Mean W.T. (mm)
100	121.90	114.5	3.7	114.5	3.7
150	177.40	166.8	5.3	166.8	5.3
200	232.25	218.4	6.9	218.4	6.9
*225	259.30	244.1	7.6	244.1	7.6
250	286.25	269.4	8.4	269.4	8.4
*300	345.45	325.2	10.1	325.2	10.1

Minimum order quantities may apply.

* Subject to minimum order quantity and availability.



Manual site handling of light weight DN 150 S2 PN 16 APOLLO™ BLUE.

Limitations: APOLLO™ and APOLLO™ BLUE PVC-O pressure pipes should not be used:

- With aromatic and chlorinated hydrocarbons, ketones, esters and ethers
- At any service temperature above 50°C
- Where provision for temperature derating has not been made above 20°C
- With compressed air
- Without adequate support to the pipe both in above ground and below ground applications
- Without adequate thrust support
- Where depth of cover is less than:
 - 300mm where pipeline is not subject to vehicular loadings
 - 450mm where pipeline is subject to vehicular loadings not in roadways
 - 600mm where pipeline is subject to vehicular loading in sealed roadways
 - 750mm where pipeline is subject to vehicular loading in unsealed roadways
 - 750mm where pipeline is subject to construction equipment loadings
- Without provision for fatigue design to accommodate dynamic stresses where appropriate (in accordance with published PIPA guidelines)
- Where working pressure plus surge/cyclic pressure exceeds the nominated pressure performance rating of the pipe
- When exposed to direct sunlight above ground for applications or storage exceeding 24 months without protection.
- This protection may include pale coloured UV resistant paint systems, nonexposed location or physical shading
- Never tap service connections directly into the pipe wall. Always use a full encirclement tapping band, designed for PVC pipe.